



SECTION A

CONCRETE SHALL BE CLASS 3- 3000PSI

\* NOTE: CITY ENGINEER SHALL DETERMINE  
APPLICABLE COMMERCIAL TYPE ENTRANCE  
BASED ON LOCATION & OTHER SITE  
CONDITIONS.

CURB AND GUTTER SHALL BE POURED  
SEPARATELY FROM THE SIDEWALK.  
CITY INSPECTION REQUIRED ON FORM WORK  
PRIOR TO POUR.

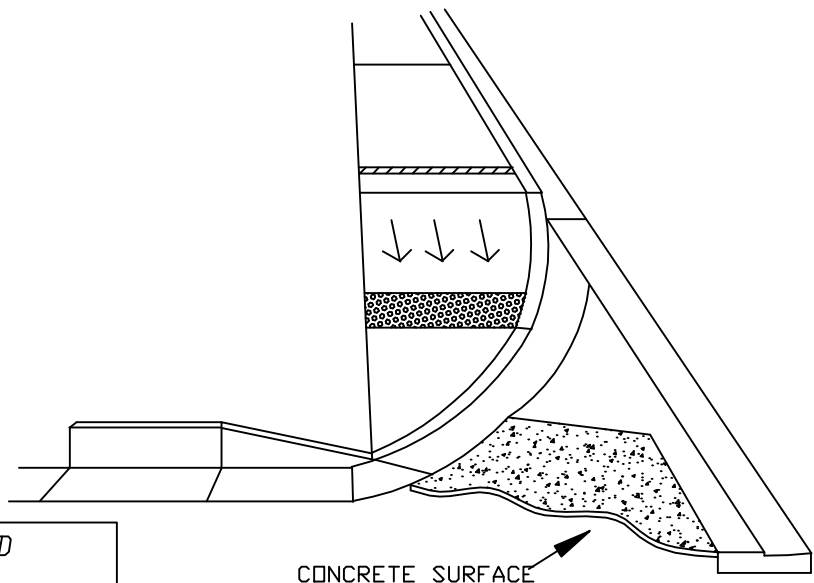

# CITY OF EDMONDS

## REVISIONS

APPROVED BY	DATE
D. GEBERT	10/6/03
D. GEBERT	06/27/05
D. GEBERT	04/2/07

## STANDARD DETAIL

### MULTI-FAMILY/ COMMERCIAL HIGH TRAFFIC LOAD DRIVEWAY ACCESS (WITH CONCRETE DRIVEWAY APPROACH)

DATE 7/24/01

SCALE NTS

DWG NO. E227.1